

OPEN ACCESS

Unstable behaviour of RPT when testing turbine characteristics in the laboratory

To cite this article: T K Nielsen and M Fjørtoft Svarstad 2014 *IOP Conf. Ser.: Earth Environ. Sci.* **22** 032038

View the [article online](#) for updates and enhancements.

You may also like

- [Comprehensive experimental and numerical analysis of instability phenomena in pump turbines](#)
Ch Gentner, M Sallaberger, Ch Widmer et al.
- [Experimental research on flow field of high head pump turbine based on PIV test](#)
D M Liu, L B Ma, N Li et al.
- [CFD Investigation of Complex Phenomena in S-Shape Region of Reversible Pump-Turbine](#)
C Jacquet, R Fortes-Patella, L Balarac et al.



ECS
The
Electrochemical
Society
Advancing solid state &
electrochemical science & technology

DISCOVER
how sustainability
intersects with
electrochemistry & solid
state science research

Unstable behaviour of RPT when testing turbine characteristics in the laboratory

T K Nielsen¹ and M Fjørtoft Svarstad²

¹ Professor, e-mail: torbjorn.nielsen@ntnu.no,

² Research Assistant, e-mail: magni.f.svarstad@ntnu.no

Norwegian University of Science and Technology, Water Power Laboratory

Abstract. A reversible pump turbine is a machine that can operate in three modes of operation i.e. in pumping mode, in turbine mode and in phase compensating mode (idle speed). Reversible pump turbines have an increasing importance for regulation purposes for obtaining power balance in electric power systems. Especially in grids dominated by thermal energy, reversible pump turbines improve the overall power regulating ability. Increased use of renewables (wind-, wave- and tidal power plants) will utterly demand better regulation ability of the traditional water power systems, enhancing the use of reversible pump turbines. A reversible pump turbine is known for having incredible steep speed – flow characteristics. As the speed increases the flow decreases more than that of a Francis turbines with the same specific speed. The steep characteristics might cause severe stability problems in turbine mode of operation. Stability in idle speed is a necessity for phasing in the generator to the electric grid. In the design process of a power plant, system dynamic simulations must be performed in order to check the system stability. The turbine characteristics will have to be modelled with certain accuracy even before one knows the exact turbine design and have measured characteristics. A representation of the RPT characteristics for system dynamic simulation purposes is suggested and compared with measured characteristics. The model shows good agreement with RPT characteristics measured in The Waterpower Laboratory. Because of the S-shaped characteristics, there is a stability issue involved when measuring these characteristics. Without special measures, it is impossible to achieve stable conditions in certain operational points. The paper discusses the mechanism when using a throttle to achieve system stability, even if the turbine characteristics imply instability.

1. Introduction

In all reaction turbines, the speed of rotation will have an influence on the flow. In general, a low specific speed Francis turbine will have steeper characteristics than a high specific speed Francis. This is mainly due to the acting centripetal forces. Dependent of the ratio between inlet and outlet diameter, the pumping effect will be different in different machines. For a low specific speed Francis, the inlet diameter is much larger than the outlet diameter, hence the centripetal forces works against the driving pressure. This results in a throttling effect, which decreases the flow when the speed of rotation increases. If the outlet diameter is the larger one, the effect will be opposite, the flow increases when the speed of rotation increase, see Figure 1.



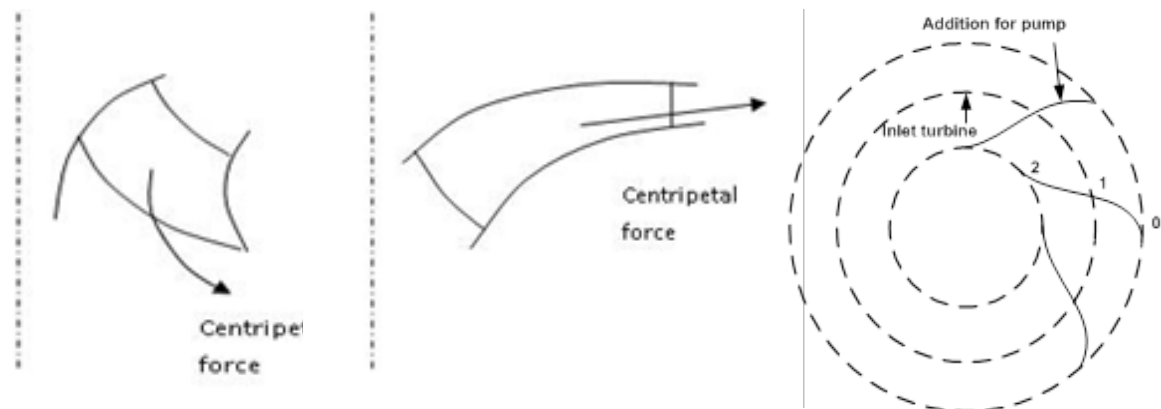


Figure 1: The effect of centripetal force on a low and high specific speed Francis turbine. The figure to the right shows the principal difference between a Francis turbine and a RPT

A RPT is a compromise between a pump and a turbine; in fact the geometry is more similar to a centrifugal pump than that of a Francis turbine. In order to have a stable pump, the pump outlet angle must be tilted backwards. The Figure 1, right figure below the principal difference. Both the difference in diameters and the smaller inlet angle makes the RPT characteristics steeper than that of a Francis turbine with the same specific speed.

A simulation model is developed that takes into account the pumping behaviour of Francis turbines as the speed of rotation increases. The model includes both the effect of the increased difference between the inlet and outlet diameter, and the effect of the small inlet angle (i.e. the outlet angle in pumping mode of operation) [3]

Figure 2 shows simulated N_{ED} - Q_{ED} diagram for a RPT compared with measurement on a model turbine in the Waterpower laboratory at NTNU. The similarity is so good, that we have confidence that the numerical model of the RPT can be used for further analysis.

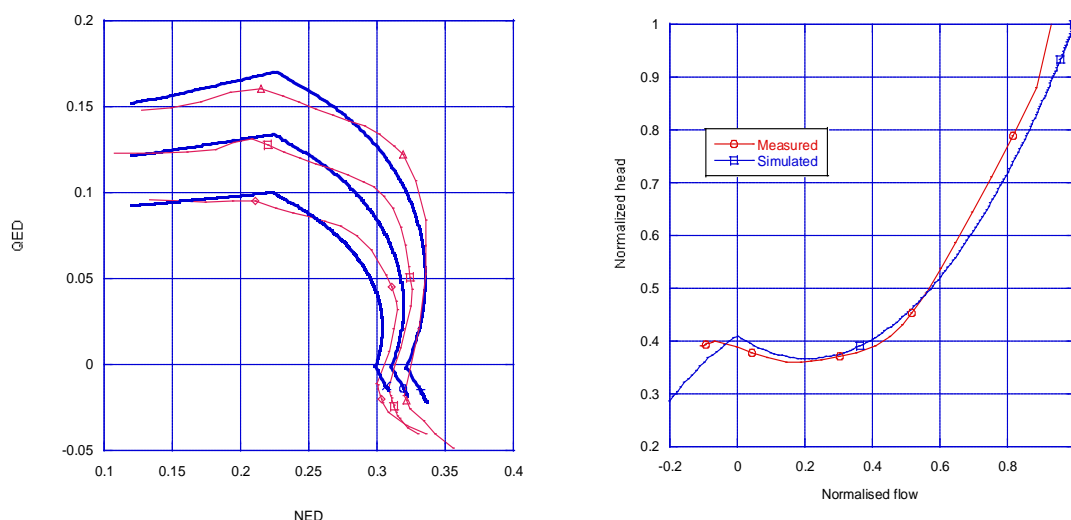


Figure 2: Simulation of RPT characteristics compared with model measured characteristics (left). Flow-Head characteristics at one of rotation (right)

2. Flow-Head characteristics

In prototype operation, the speed of rotation is of course the synchronous speed. Because of variation in the head, a more relevant representation is the Flow – Head characteristics

The definitions of N_{ED} and Q_{ED} are:

$$N_{ED} = \frac{nD}{\sqrt{gH}} \quad \text{and} \quad Q_{ED} = \frac{Q}{D^2 \sqrt{gH}} \quad (1)$$

The characteristics may be transformed, representing a given speed of rotation, one characteristic for each guide vane opening. The same S-shape of the N_{ED} - Q_{ED} characteristics can be observed also in the Flow-Head characteristics. The characteristics get a negative slope as the head decreases, see Figure 3.

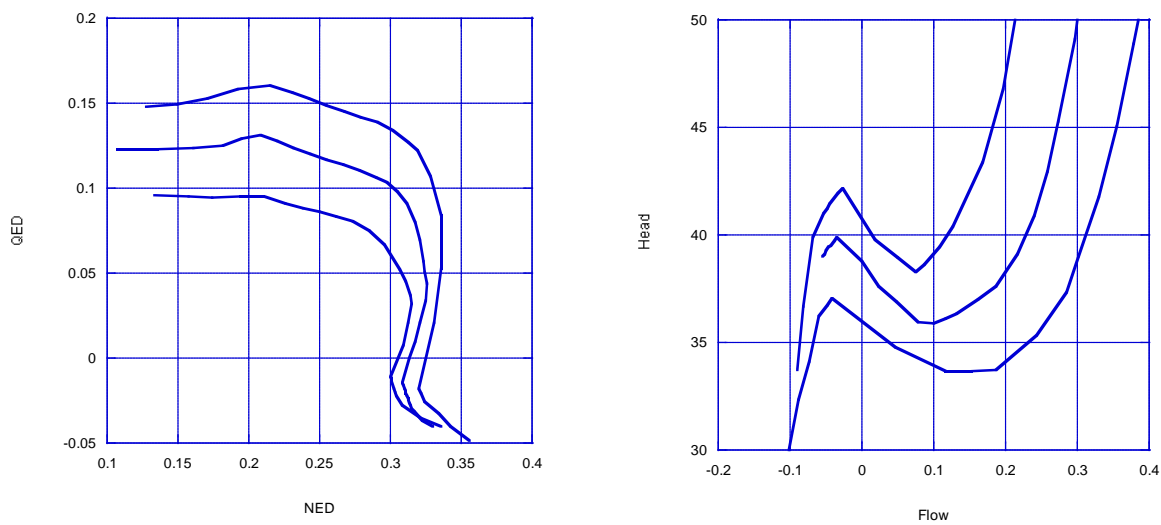


Figure 3: Measured Q_{ed} - N_{ed} characteristics (left) transformed to a Flow-Head characteristics for constant speed of rotation, different guide vane opening (right)

3. Stability criteria

The turbine characteristic is often characterized as stable or unstable. In reality a characteristic by its own can be neither stable nor unstable, it has to be seen in relation to the water power system as a whole. [1]

A water power system with no surge shaft can be represented by the differential equation:

$$\frac{L}{gA} \frac{dQ}{dt} = H_o - H_f - H_t \quad (2)$$

The head loss is: $H_f = K_f Q^2$. The turbine head, H_t , consists of two terms, one term is similar to the valve equation (as for a Pelton turbine) the other term is a function of the speed of rotation. It is important to note that the different K 's in these equations are not constants, but transients in interaction with the system.

H_t can be represented by:

$$H_t = (K_r + K_n) Q^2 \propto K_t Q^2 \quad \text{where} \quad K_n = f(n) \quad (3)$$

With a perturbation q on the steady state flow Q_0 inserted in equation 2:

$$\frac{L}{gA} \frac{d(Q_0 + q)}{dt} = H_o - K_f(Q_0 + q)^2 - K_t(Q_0 + q)^2 \quad (4)$$

Subtracting $\frac{L}{gA} \frac{dQ_0}{dt} = H_o - K_f Q_0^2 - K_t Q_0^2$

and neglecting second order terms gives the differential equation for the perturbation:

$$\frac{dq}{dt} = -\frac{Ag}{L} (2K_f Q_0 + 2K_t Q_0) q \quad (5)$$

Separation of the variables:

$$\frac{dq}{q} = -\frac{Ag}{L} (2K_f + 2K_t) Q_0 dt \quad (6)$$

The solution is:

$$q = e^{\frac{Ag}{L} (-2K_f - 2K_t) Q_0 t} \quad (7)$$

This is unstable when: $K_f + K_t < 0$ (8)

With a negative slope for the turbine in the QH-diagram we have the necessary conditions for instability in the system. In the laboratory, the head loss is small, i.e. $K_f \sim 0$, so the instability basically occurs when the turbine characteristic is negative. The Figure 4 below, shows the characteristic of one guide vane opening. The system is stable at high head. Reducing the head, the system becomes unstable.

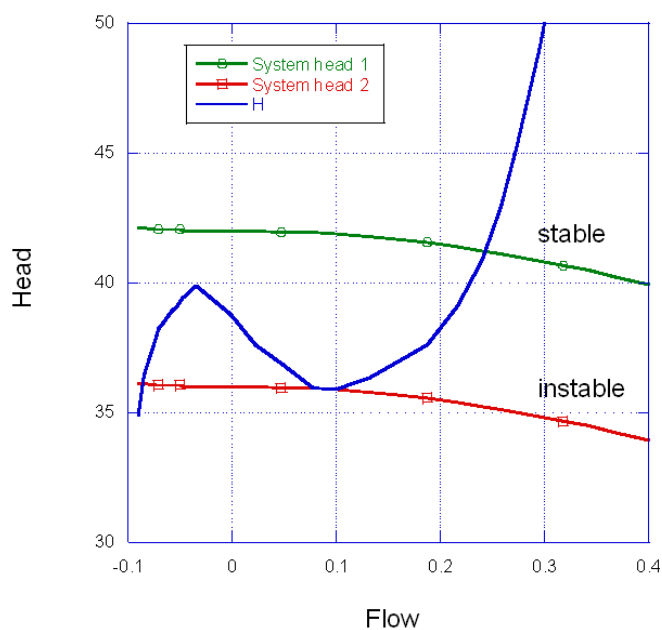


Figure 4: Stable and unstable operational point as the system head changes shown in Flow-Head diagram

The negative slope of the turbine characteristics as shown in the Figure 4, means that K_t is negative. Since the stability criterion for the system is $K_f + K_t > 0$ it follows that the additional head loss in the system will have to be $K_f > -K_t$ to have stable conditions in the system as a whole.

The stability problem during RPT tests occurs when approaching the runaway curve in the N_{ED} - Q_{ED} diagram, which is the point where the turbine Flow-Head characteristic becomes negative, approaching the criteria for instability in eq.8.

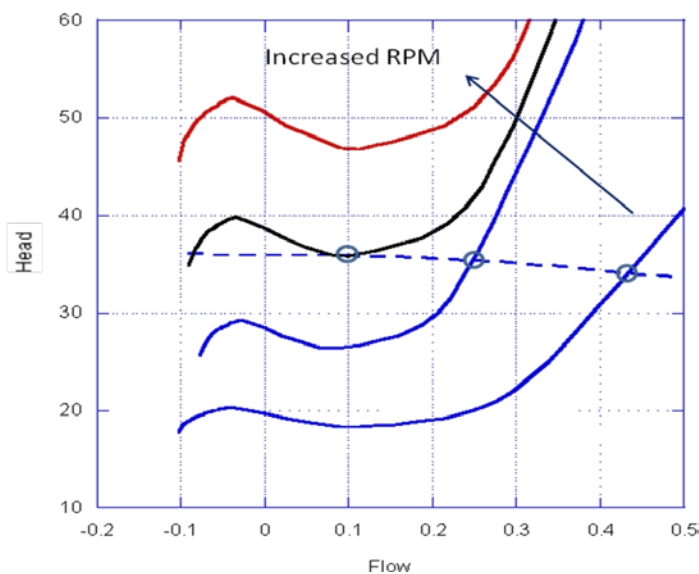


Figure 5: Flow-Head characteristics at increasing speed of rotation (the operation point at increasing speed of rotation is marked with o's).

Using the definition of N_{ED} and Q_{ED} , the Q-H characteristics for different speed of rotation can also be determined. The characteristics are shown in Figure 5.

With a given reservoir head indicated by the dotted line, the unstable operation point will be reached by increasing speed of rotation and there will be problems to measure the characteristics further on.

4. Stabilization by means of a throttle valve

In the laboratory, there is mounted a throttle valve in front of the model RPT. The principal system is as shown in Figure 6.

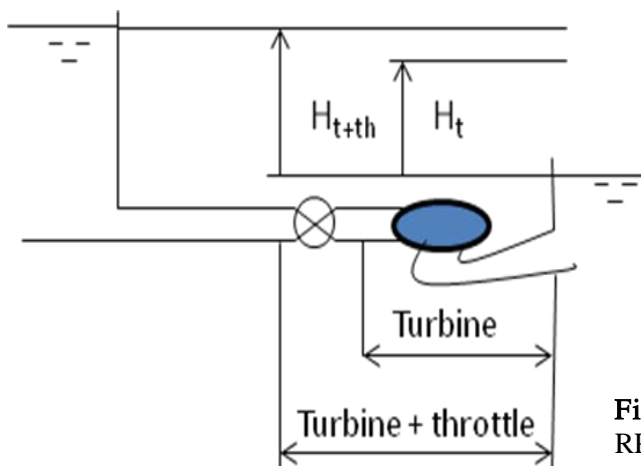


Figure 6: Test arrangement showing the model RPT and the throttle valve in the open loop system

At the Waterpower Laboratory at NTNU, we have the possibility to perform tests in an open loop system, which is beneficial when addressing stability issues.

By adding the loss characteristic of the throttle to the turbine characteristic, one can see in the Figure 7 that even if the turbine characteristics are unstable, the turbine + throttle characteristic become stable. In the figure, the Turbine head and the head of the turbine + throttle, i.e. the System head, are shown. In the equations for N_{ED} and Q_{ED} , it is the turbine head that is comes in.

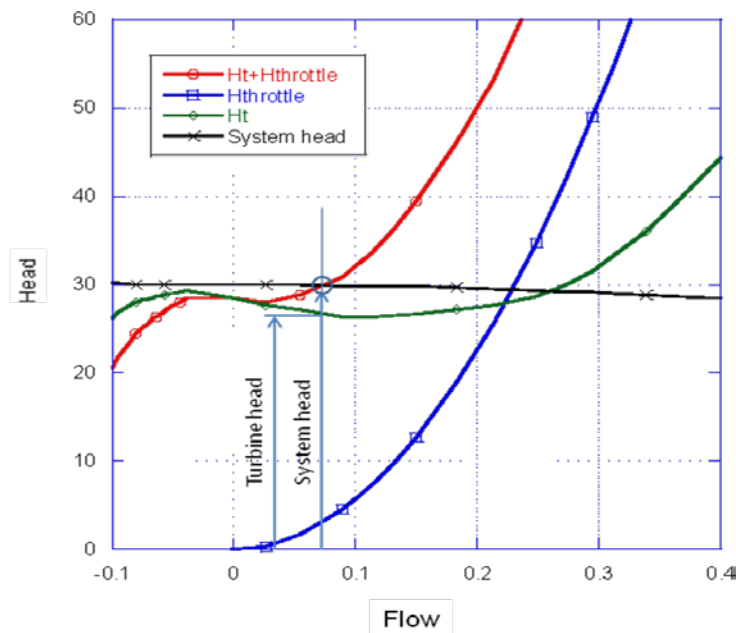


Figure 7: Illustration of how the operational point of the system becomes stable even if the turbine characteristics imply instability

5. Simulations

The test arrangement at The Waterpower Laboratory has been modeled with the RPT running in open loop, with a free surface reservoir as head water and free surface tail water. At the up-stream side of the turbine, there is a pressure tank acting as an air cushion. The turbine model mentioned in the introduction is used for the turbine characteristics. The stability criterion, ch. 3, is developed as static criteria, so in order to visualize oscillations, the air cushion is necessary to introduce a compliancy in the system.

In addition to the turbine model mentioned, the simulation model includes the equation of motion for the upper pipe, the continuity and the equation of stat for the air cushion compliance and water hammer equations for the pressure pipe.

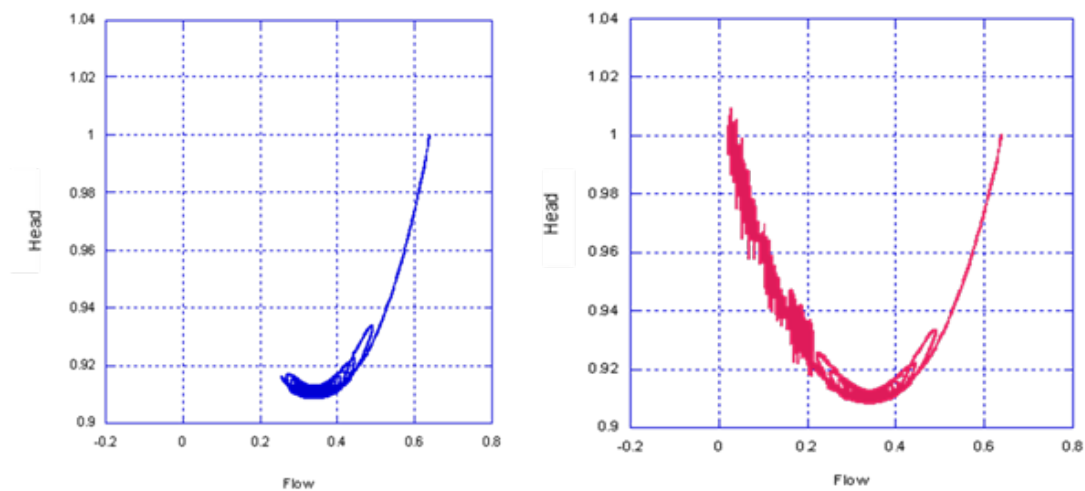


Figure 8: Behaviour as the RPT reaches the unstable operational point

Starting with normalized head 1 with a speed of rotation which brings the operational point near instability, and then giving a small perturbation of head, the Figures 8 and 9 show the transient performance as the perturbation is increased.

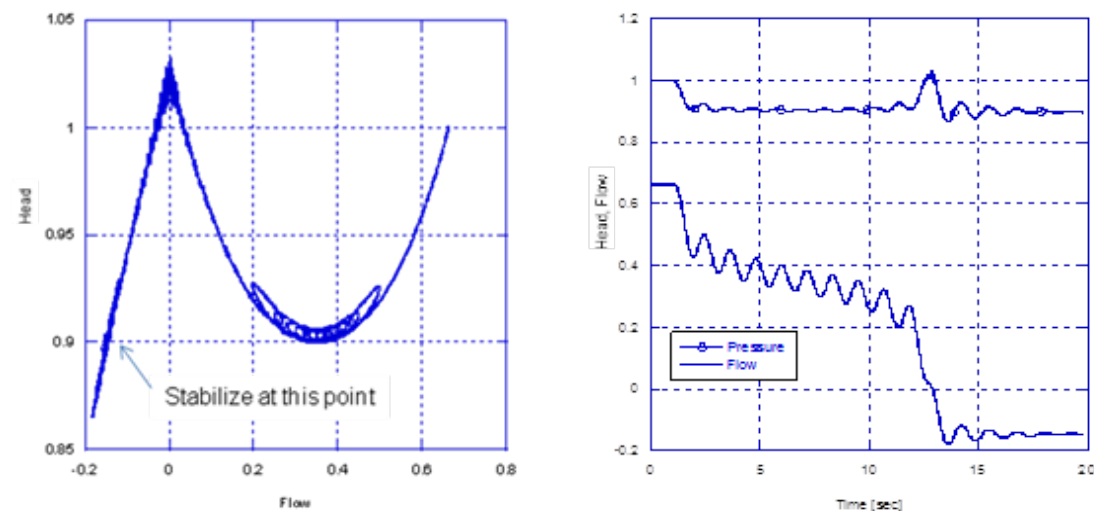


Figure 9: With higher perturbation in head, the turbine will stabilize at negative flow, more or less following the turbine

Utterly increasing the head perturbation, the turbine will take off and end up with negative flow, as shown in Figure 9. The performance will stabilize at negative flow.

6. Conclusion

Measuring the S-curves of a RPT always gives challenges. Using a throttle valve to stabilize the system is well known by the turbine laboratories. [2]. The intention of this paper is to explain the reason why, even if the RPT characteristic are unstable, the system becomes stable. How the real behavior of the turbine is, when instability occurs, is shown by the simulations.

When performing laboratory tests and this happening occurs, the observation is that the RPT goes from positive flow to negative flow in a relative short time. We have, up till now, only preliminary

measurements of head, flow and speed of rotation to verify the simulated transient behavior. The main problem is to measure the transient flow. With good results, we have previously used the Gibson method for transient flow measurements, and in near future, we intend to use this method to do measurements in the transient period, verifying or falsifying the simulations.

The normal assumption regarding this transient behavior is that the operation point jumps from positive to negative flow as illustrated in Figure 10.

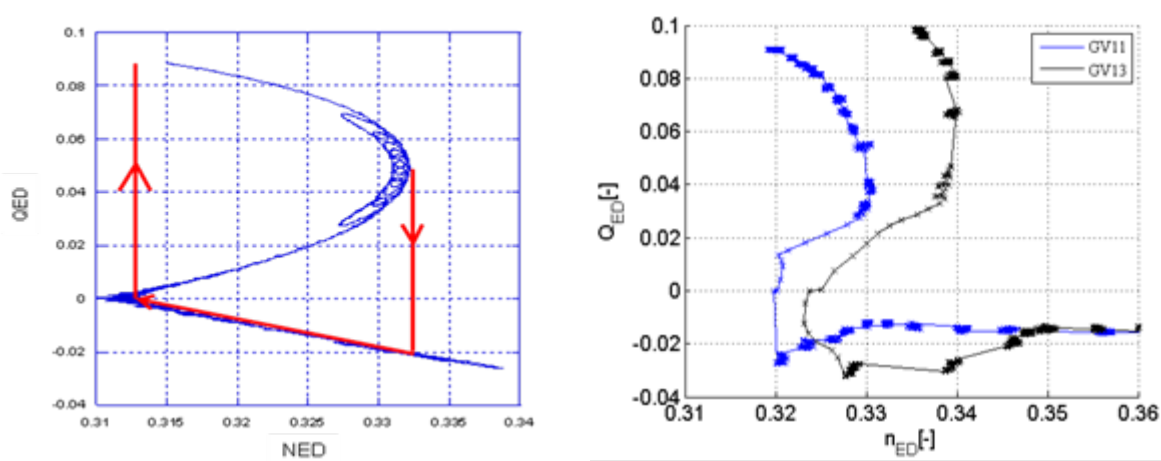


Figure 10: Simulated (left) and measured (right) performance, two wicket gate openings in N_{ed} - Q_{ed} diagram.

However, we have reasons to believe that the performance follows the characteristics more like that the simulation shows and the preliminary measurements indicate. *Natura non facit saltus* [Leibnitz]

Symbol list

Symbol	Quantity	Unit
H	Head	m
Q	Flow	m ³ /s
D	Turbine outlet diameter	m
N_{ED}	Dimension less rotational speed	-
Q_{ED}	Dimension less flow	-
K_t, K_n, K_r	Loss factor, turbine	
K_f	Loss factor, system	
g	Gravitational constant	m/s ²

References

- [1] Staubli T et al 2010 Starting pump-turbines with unstable characteristics *Conf.: Hydro 2010*
- [2] Dörfler P K et al 1998 Stable Operation Achieved on a Single-Stage Reversible Pump-Turbine Showing Instability at No Load *Proc. XIX IAHR Symposium on Hydraulic Machinery and Cavitation, Singapore*
- [3] Nielsen T K and Olimstad G Dynamic 2010 Behaviour of Reversible Pump-Turbines in Turbine Mode of Operation *The 13th Internat. Symp. on Transport Phenomena and Dynamics of Rotating Machinery, Honolulu, Hawaii*